DUTY STANDBY DUAL FOUL PUMP STATION WITH REGO1

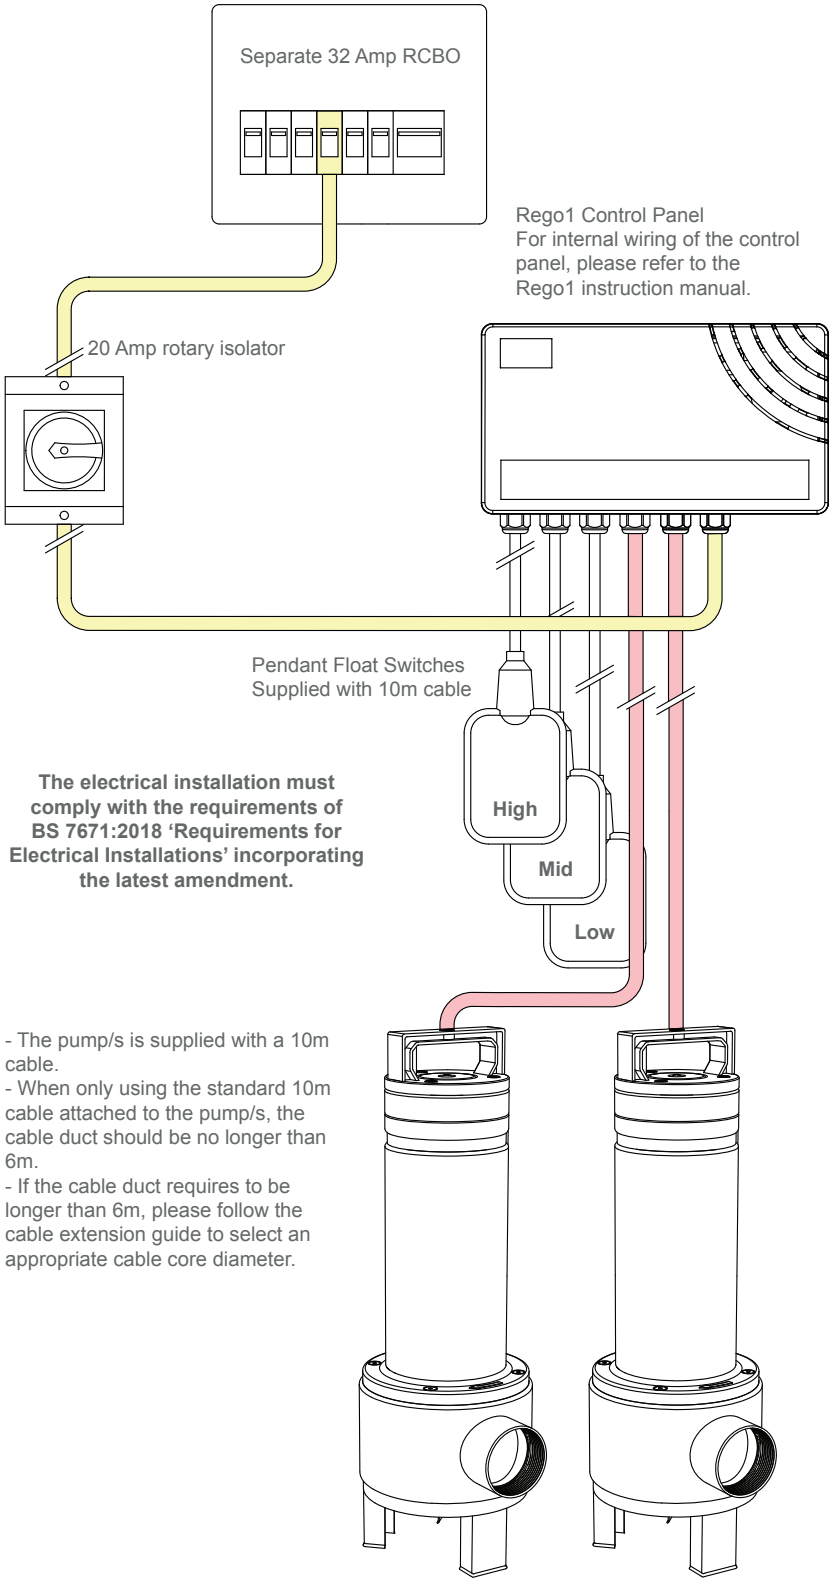

The electrical installation must comply with the requirements of BS 7671:2018 'Requirements for Electrical Installations' incorporating the latest amendment.

- The pump/s is supplied with a 10m cable.
- When only using the standard 10m cable attached to the pump/s, the cable duct should be no longer than 6m.
- If the cable duct requires to be longer than 6m, please follow the cable extension guide to select an appropriate cable core diameter.

PACKAGED PUMPS SYSTEMS LTD (PPS)
Unit 11 Haslemere Ind. Est., Pig Lane, Bishops Stortford, Herts. CM23 3HG
info@ppspumps.com | 0330 9000 999
www.ppspumps.com