


SINGLE FOUL WATER PUMP STATION WITH ALERTMAXX2 AND HI-POWERMAXX2-XL

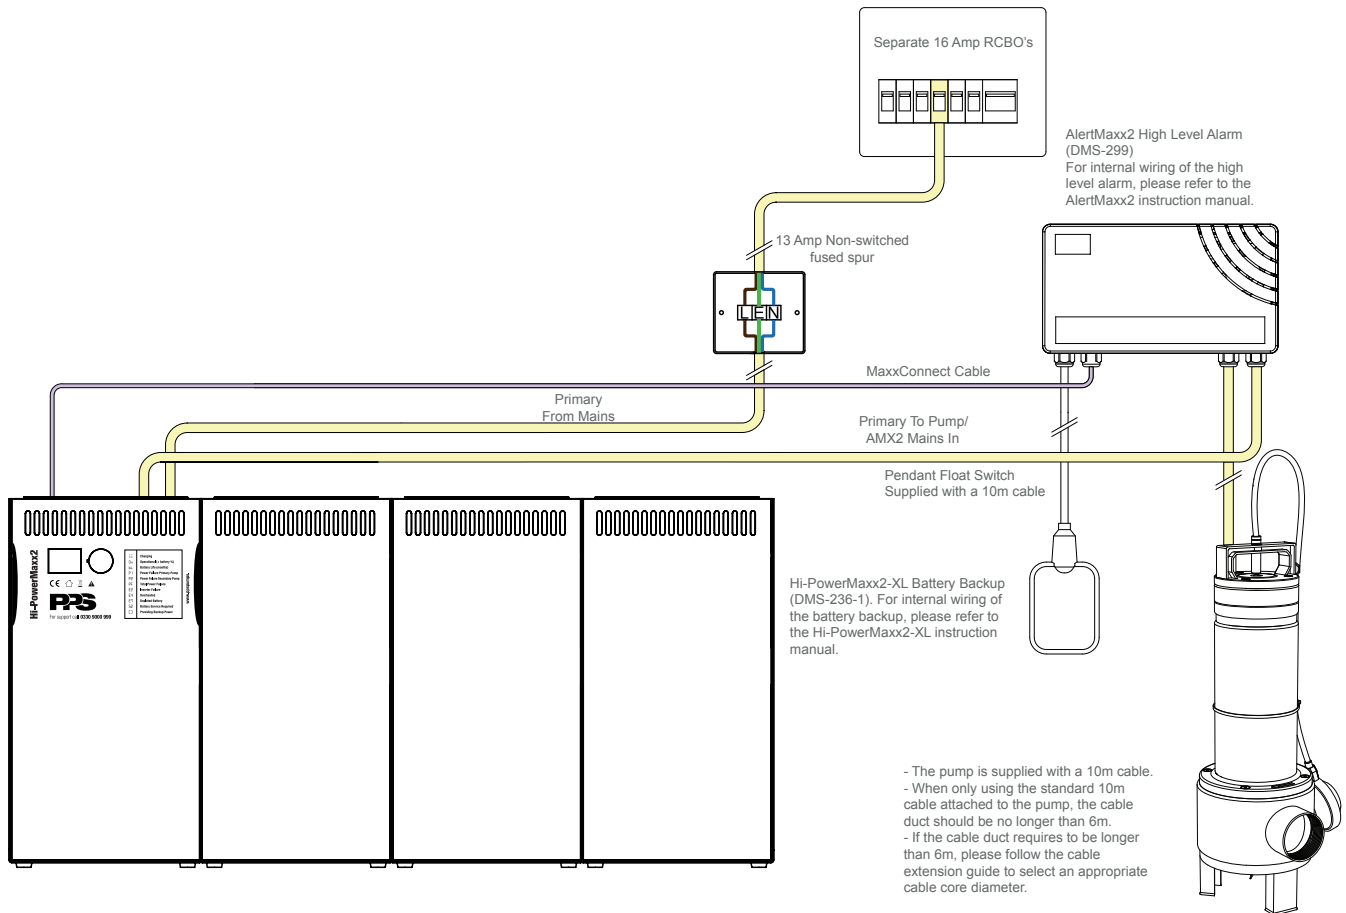

The electrical installation must comply with the requirements of BS 7671:2008 'Requirements for Electrical Installations' incorporating the latest amendment.